Supplemental Digital Content 1: CONSORT flow diagram showing selection of infants for rotavirus sub-study and subsequent enteropathogen analysis.

[1] No sample available, insufficient post-vaccine sample or assay failure
[2] Insufficient or no pre-vaccine sample available
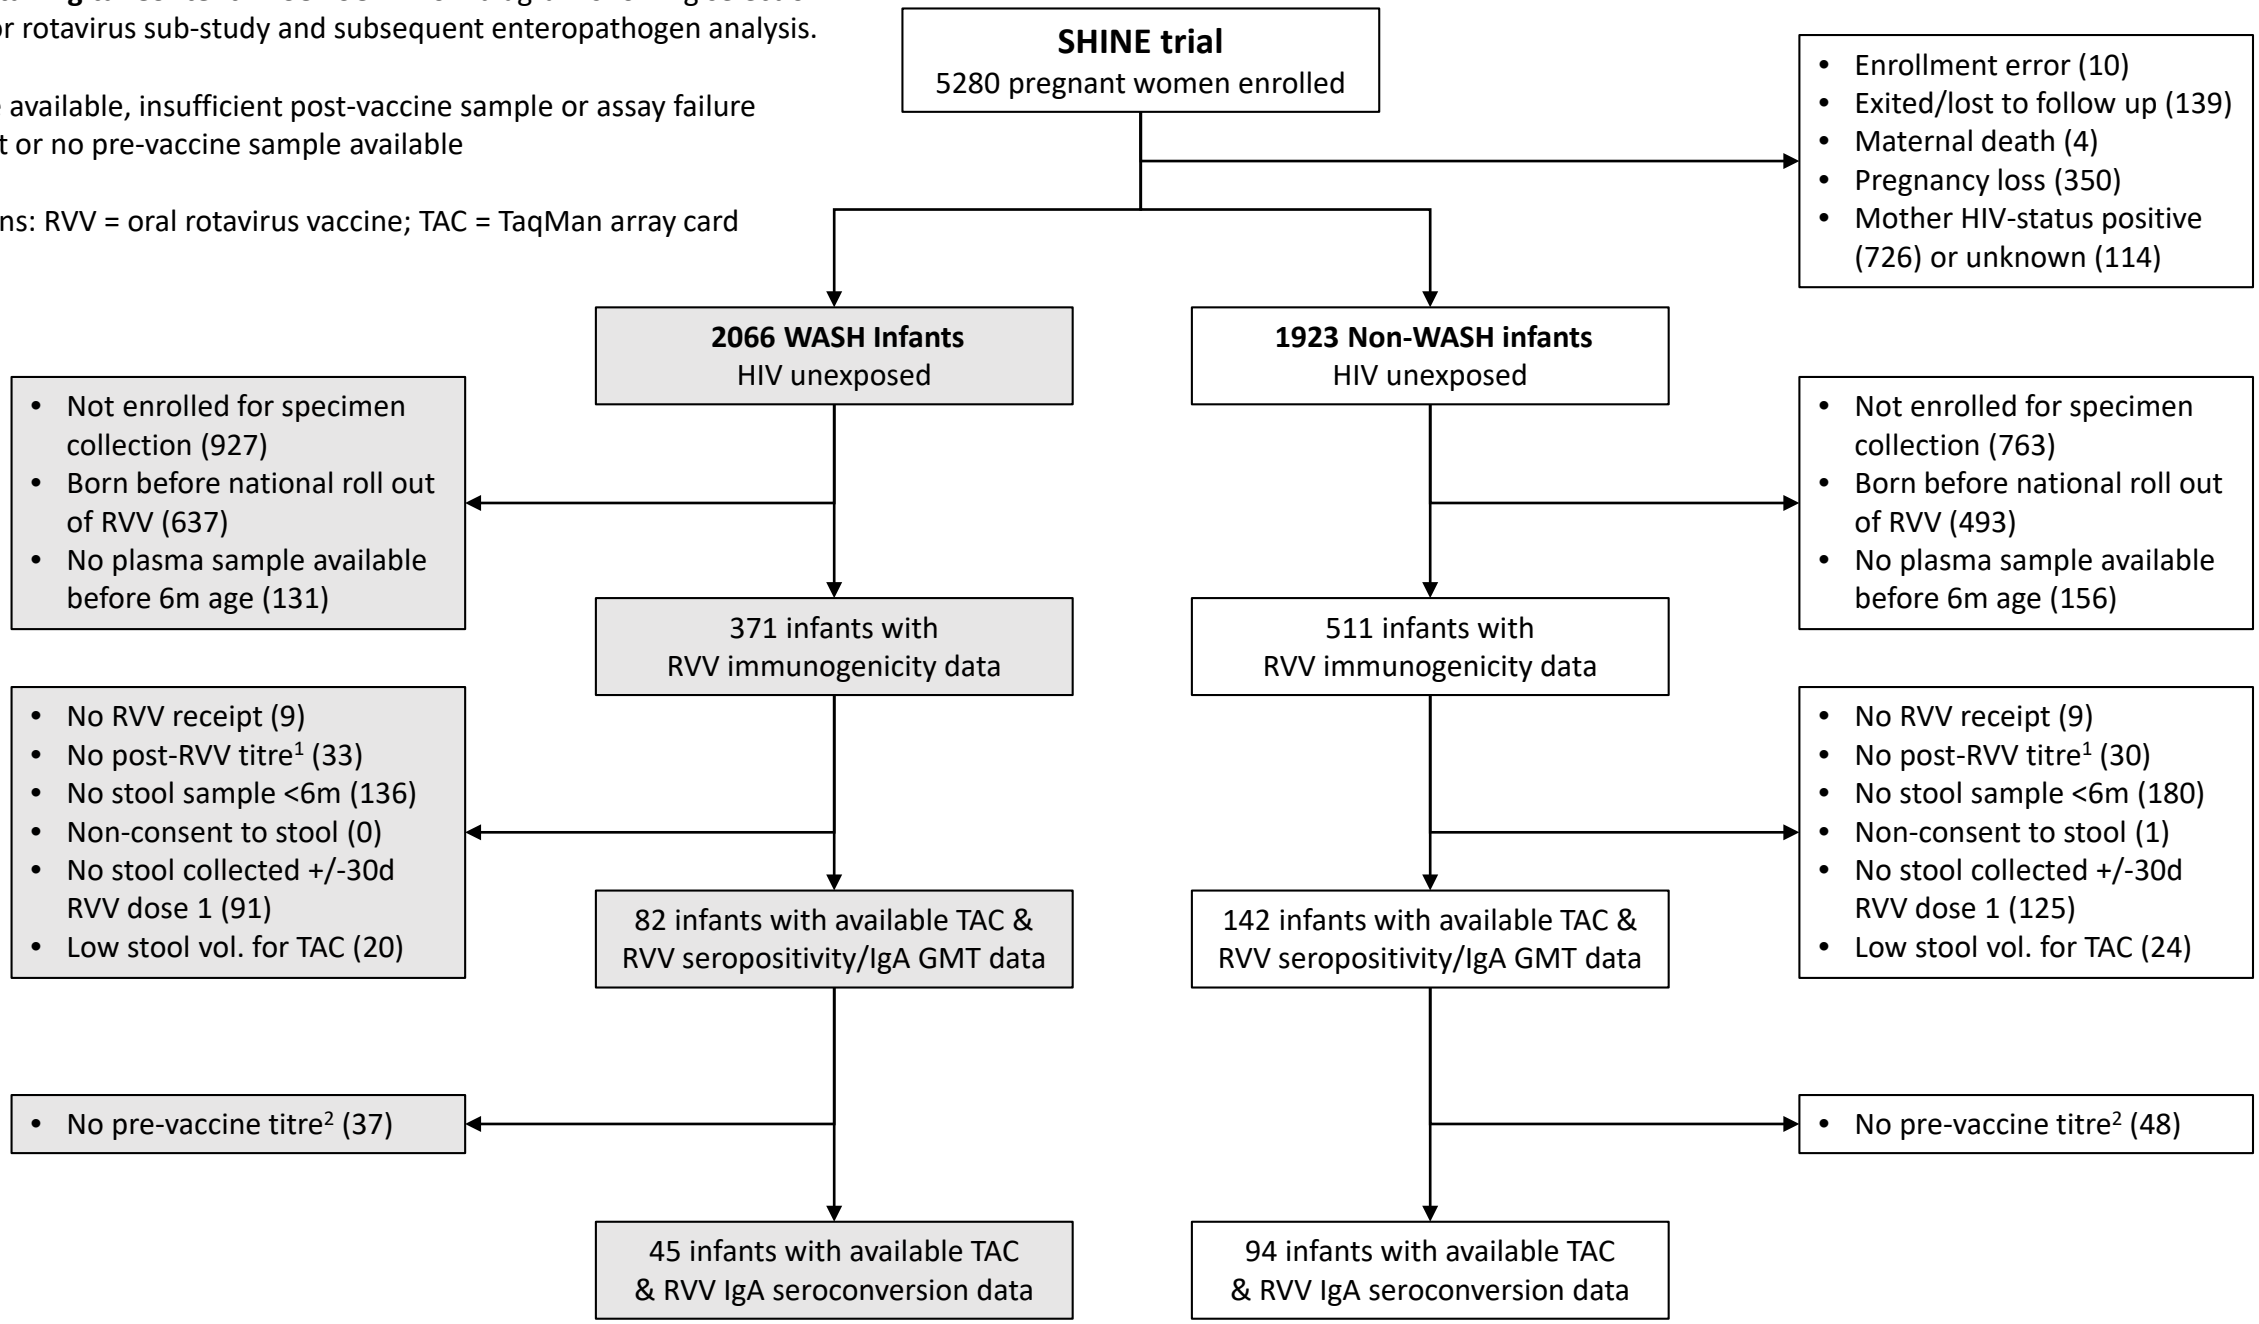
Abbreviations: RVV = oral rotavirus vaccine; TAC = TaqMan array card